

Cloud VAV Controller set with Room Unit of Choice and Integrated pressure sensor, controller and damper actuator for pressure-independent temperature control VAV, Simple VAV and Demand Control Ventilation applications in the comfort zone.

- NFC interface for Smartphone Powerless Commissioning
- Workforce Efficiency Improvement with Cloud operation
- BACnet MS/TP Integration
- With AI for CO₂ sensor
- Standardized Control Applications for easy implementations.



22RT-A001



22RT-A002



22RT-A003



LMV-BAC-001



LMV-BAC-002

Set Type	ZoneEase VAV Controller Actuator	Room Unit
ZE-SET001	LMV-BAC-001	22RT-A001
ZE-SET002*	LMV-BAC-001	22RT-A002*
ZE-SET003	LMV-BAC-001	22RT-A003
ZE-SET004	LMV-BAC-002	22RT-A001
ZE-SET005*	LMV-BAC-002	22RT-A002*
ZE-SET006	LMV-BAC-002	22RT-A003

Brief description

Application	The ZoneEase VAV has PI control characteristics and is used for pressure-independent temperature control of VAV units in the comfort zone.
Pressure measurement	The integrated maintenance-free Belimo D3 pressure valve sensor is also suitable for very small volumetric flows. It is for this reason that it enables versatile applications in the comfort zone, e.g. in offices, hospitals, hotels, residential construction, cruise ships, etc.
VAV – Temperature control	For pressure-independent temperature control VAV applications, room temperature is obtained from Room Unit. Room Temperature Setpoint is obtained from the Room Unit through manual buttons (22RT-A001 only) or APP or from command through BACnet MS/TP. The operating range \dot{V}_{min} ... \dot{V}_{max} or reheating valve or electric reheater are controlled based on heating demand or cooling demand, depending on temperature difference (setpoint minus actual), P-Band value (adjustable) and Tn value (adjustable Integral gain)
VAV/CAV – variable/constant volumetric flow control	For variable volumetric flow applications with a modulating reference variable, The operating range \dot{V}_{min} ... \dot{V}_{max} can be controlled via BACnet, APP or Room Unit (22RT-A001)
VAV – Demand Control Ventilation (DCV)	For DCV applications, The operating range \dot{V}_{min} ... \dot{V}_{max} are controlled based on demand, depending on CO ₂ difference (setpoint minus actual), Tn_CO ₂ value (adjustable) and Tn_CO ₂ value (adjustable)
Integration	BACnet MS/TP integration
BACnet function	Addressable from 1 to 127 in a singular BACnet MS/TP network. Recommended to have repeater for every 32 BACnet Devices. Entire BACnet internetwork address limited by 4194303 device, as according to BACnet Limitation.
Additional Sensor integration	A CO ₂ Sensor can be connected to the ZoneEase Compact Controller for data collection purpose in Temperature controlled applications and as an control input for DCV application.
Operating and service devices	Actuator and Room Unit NFC interface for Android Smartphone Belimo Assistant App.
Test function / test display	The ZoneEase VAV features two LEDs which shows power status, bus communication, adaptation
OEM factory settings	The ZoneEase VAV is mounted on the VAV box unit by the unit manufacturer, who adjusts and tests it according to the application.

System Technical Data

Electrical Data

Nominal voltage	AC/DC 24V, 50/60Hz
Operating range	AC 19.2 ... 28.8 V DC 21.6 ... 28.8 V
Power consumption	7 VA (with LMV-BAC-002 and Room Unit), DO Full load connected 5 VA (with LMV-BAC-001 and Room Unit)

Ambient Conditions

Operating Temperature/Humidity	0...50°C / 5% tp 95% non-condensing
Storage Temperature	-40...80°C (LMV-BAC-001 / LMV-BAC-002 / 22RT-A002 / 22RT-A003) 0...60°C (22RT-A001)

Control function (application number)

- VAV-Demand Control Ventilation by CO₂ (8)
- VAV-CAV (9)
- VAV-Temperature Control
 - No Application Selected (1)
 - Cooling Only (2)
 - Cooling/Heating Only (3)
 - Cooling with Reheat 1 Stage (4)
 - Cooling with Reheat 2 Stage (5)
 - Cooling with on-off Reheat Valve (6)
 - cooling with Modulating Reheat Valve (7)
 - Cooling with Parallel Fan (10)
 - Cooling with Parallel Fan+Reheat 1 Stage (11)
 - Cooling with Parallel Fan+Reheat 1/2 Stage (12)
 - Cooling with Parallel Fan+Reheat on-off Valve (13)
 - Cooling with Parallel Fan+Reheat Modulating Valve (14)
 - Cooling with Series Fan (15)
 - Heating or Cooling with Series Fan (16)
 - Cooling with Series Fan plus Reheat 1 Stage (17)
 - Cooling with Series Fan plus Reheat 1/2 Stage (18)
 - Cooling with Series Fan plus Reheat On-Off valve (19)
 - Cooling with Series Fan plus Reheat Modulating valve (20)

Safety

Protection class	III Safety extra-low voltage
Degree of protection	IP20 (overall), IP30 (Room unit)
EMC	CE according to 89/336/EEC, EN60730-1:2000 + A2:2008, EN60730-2-14:1997 + A2:2008 EN61000-6-2:05 and EN61000-6-3:07 + A1:11, EN60730-2-9:2010
Mode of operation	Type 1 (in acc. with EN 60730-1)
Rated impulse voltage	0.8 kV (in accordance with EN 60730-1)
Control pollution degree	2 (in accordance with EN 60730-1)
Maintenance	Maintenance-free

Data for BACnet

Protocol	BACnet MS/TP (RS-485), not galvanically isolated
Number of nodes	Addressable from 1 to 127, 32 nodes per repeater
Baudrates	9 600, 19 200, 38 400 (Default), 76 800, 115 200 Bd
End of Line Termination Resistor	Required, 120 Ω typical
Parameterisation	Belimo Cloud Business Application (Access by www.ZoneEase.com or ZoneEase.Cloud.Belimo.com) Belimo ZoneEase VAV App (Google Play Store (www.google.xx) or Baidu Mobile Assistant (shouji.baidu.com) or 360 Mobile Assistant (sj.360.cn)) BACnet MS/TP (Please refers to datapoint list)

Protocol Implementation Conformance Statement (PICS)

Please refers to BACnet Testing Laboratories.
<http://www.bacnetinternational.net/btl/index.php?m=87>

ZoneEase VAV Controller Actuator

Actuator	Brushless, non-blocking actuator with power-save mode
Torque	5Nm
Inputs / Outputs	Analogue Input for CO2 sensor connection, 0-10V 3 x Digital Triac Output, 24VAC, max. 500 mA@room temperature
Speed	60s max full span (Boost, Manual Override), 150s max full span
Direction of rotation	cw / ccw (configurable)
Adaptation	Capture of setting range and resolution to control range
Gear disengagement	Push-button lockable/self-resetting
Sound power level	max. 35 dB (A) normal operation, max 50 dB (A) in boost mode and manual override, adaptation/ Synchronization
Angle of rotation	95° , adjustable mechanical
Spindle holder	- Spindle clamp, spindle round 10 ... 20 mm / spindle square 8 ... 16 mm - Form fit in OEM variant versions, e.g. 8 x 8 mm
NFC Communication	Yes
Connection	Pluggable terminals 0.5mm ² to 2.5 mm ² (20AWG to 14 AWG), 0.33 mm ² (22AWG) with bullet terminal or cable lug

Differential pressure sensor

Type, principle of operation	Belimo D3 sensor, dynamic response
Operating range	-20 ... 500 Pa
Accuracy	-20Pa to 20Pa (±1Pa), 20Pa to 500Pa (±5% of measured value)
Overload capability	±3000 Pa
Measuring air conditions	0...+50 °C / 5...95% rH, non-condensating
Installation position	Any, no reset necessary
Materials in contact with medium	Glass, epoxy resin, PA, TPE
Operation and servicing	Actuator and Room Unit NFC interface for Android Smartphone ZoneEase VAV App
Push-button	Adaption
LED display	Display Power, Status and Communication

Room Unit Wall / Room Unit Ceiling

Operation Mode	Active, Off, Eco, Boost, Anti-frost (built-in, self triggered), Occupancy (triggered by external occupancy sensor if available)#
Color	White
LCD Display	Backlight (White)&
Setpoint range	10...30 °C (High/low limit configurable)
Sensing element accuracy	+/-0.3 °C at 15...30 °C
Display resolution	+/-0.5 °C
NFC Communication	Yes
Wiring terminals	toolless push-in terminal, 0.5mm ² to 1.5 mm ² (20 AWG to 16 AWG)
Power supply for external device	10W, such as presence detector
Datapoint list (BACnet, APP, Cloud)	Refers to Datapoint list document

Remark: #Occupancy contact only available with Model 22RT-A001 and 22RT-A003

&LCD Display only available with Model 22RT-A001

Connection

Connecting terminals The connection is made using the pluggable terminals to the ZoneEase VAV device.

Note

- Supply via safety isolating transformer!
- Connections 1 and 2 (AC 24V) and 5 (MP signal) must be routed to accessible terminals (ZoneEase Wall Unit, 22RT-A001 or ZoneEase Ceiling Unit, 22RT-A002 or 22RT-A003) for temperature sensing in order to enable access with the tool for diagnostic and service work.



LMV-BAC-001




Designatio	Function
D+	BACnet +
D-	BACnet -
⊥	AC 24V supply
~	
S	CO2 input
MP	– MP-Bus connection
➔ 1	Digital Output 1
➔ 2	Digital Output 2
➔ 3	Digital Output 3
COM	Digital Output Common


LMV-BAC-002



Digital Output connection

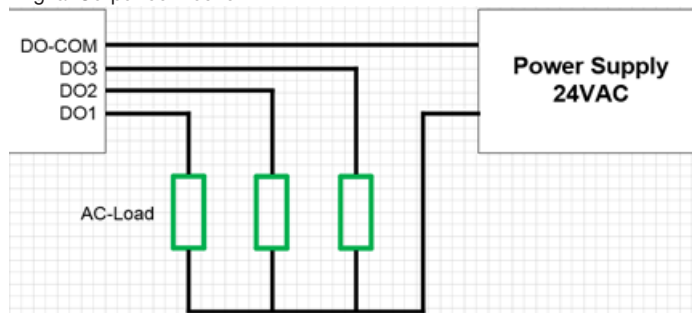

BACnet MS/TP

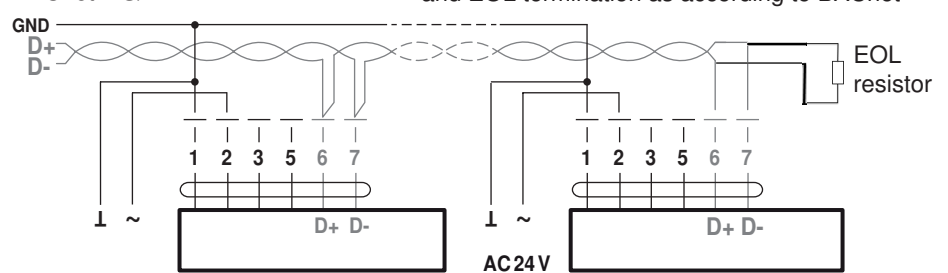

Dimensioning of supply and connecting cable

General In addition to the actual wire sizing, attention must also be paid to the surrounding area and the cable routing. Signal cables must not be laid in the vicinity of load cables, objects liable to cause EMC interference etc. If possible, Shielded Paired or Shielded layer stranded cables improve immunity to interference, refers to BACnet Standard and recommendations.

24 V supply, dimensioning and cabling The dimensioning and installation of the AC 24V supply, the fuse protection and the cables are dependent on the total operated load and local regulations. Account must be taken of the following performance data, including the starting currents of the actuators:

- Other devices which are intended to be connected to the same 24 V supply
- Reserve capacity for subsequent expansion, if planned.

Tool connection

Settings and diagnostics

For Portable Testing and Commissioning of the VAV unit, the ZoneEase VAV can be operated via the integrated NFC interface using the Smartphone ZoneEase APP.

Belimo Cloud Business Application support workforce efficiency improvement by creating a working platform for OEMs, SIs, Project Managers, Consultants and Building Owners to prepare, configure, calibrate, manage, review and maintain VAV system throughout the product lifecycle.

Smartphone – Belimo Assistant App

NFC-capable devices

- LMV-BAC-001, LMV-BAC-002, 22RTA001, 22RTA002, 22RTA003, with NFC mark

The NFC antenna range of the ZoneEase VAV is located between Belimo or the OEM logo and the NFC mark.

Align NFC-capable Android Smartphone, with Assistant App loaded, in such a way on the ZoneEase VAV that the two NFC antennas are above one another.



Depending on the model of the Smartphones, its antenna could be located at a different position (see documentation for the Smartphone).

Compatibility



Replacement devices When replacement devices are ordered, they are parameterised with Mobile APP in accordance with the installed system.

Safety notes

- The device is not allowed to be used outside the specified field of application, especially in aircraft or in any other airborne means of transport.
- It may only be installed by suitably trained personnel. Legal regulations and regulations issued by authorities must be observed during installation.
- The device may only be opened at the manufacturer's site. It does not contain any parts that can be replaced or repaired by the user.
- When calculating the torque required, the specifications supplied by the damper manufacturers (cross-section, construction, place of installation), and the ventilation conditions must be observed.
- The device contains electrical and electronic components and is not allowed to be disposed of as household refuse. All locally valid regulations and requirements must be observed.




Dimensions [mm]



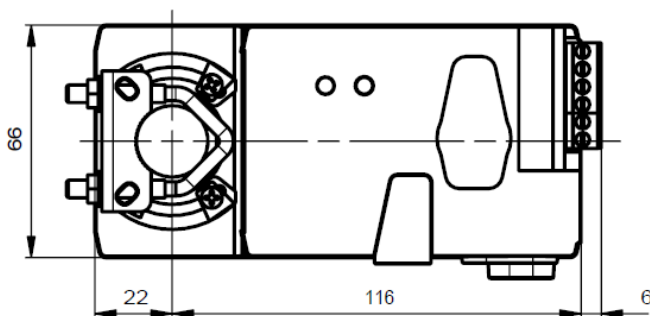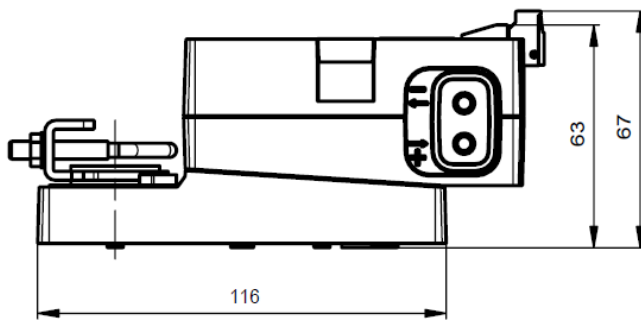





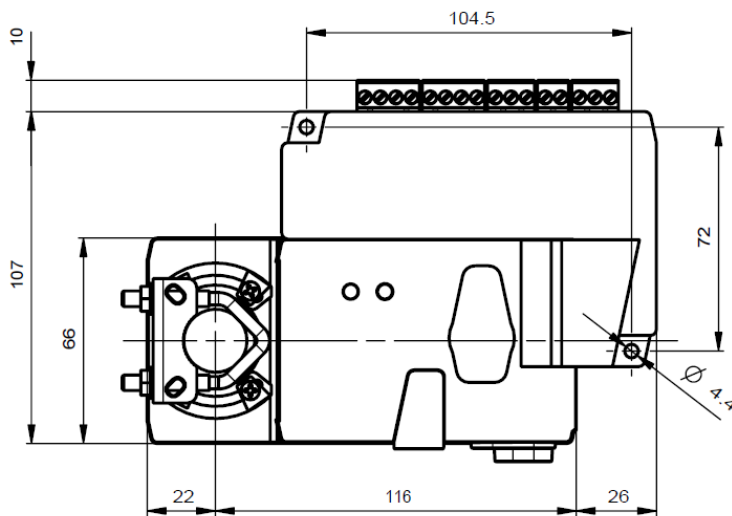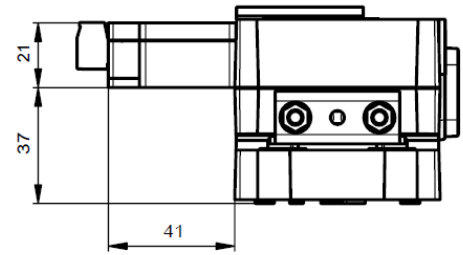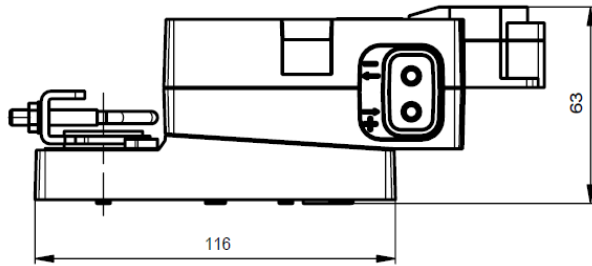















Dimensional drawings LMV-BAC-001



Dimensions [mm]

Dimensional drawings LMV-BAC-002



Application number	Application Name	LMV-BAC-001	LMV-BAC-002	22RT-A001 / 22RT-A002 / 22RT-A003	22DC-11	CQ24A-MPL-A08	
							
2	Single duct SUP/ Cooling only	●		●	○		
3	Single duct SUP – Cooling/ Heating only	●		●	○		
4	Single duct SUP – Cooling + 1 Stage Electric Reheat		●	●	○		
5	Single duct SUP – Cooling + 2 Stages Electric Reheat		●	●	○		
6	Single duct SUP – Cooling + On-Off Reheat Valve		●	●	○		
7	Single duct SUP – Cooling + Modulating Reheat Valve	●		●	○	●	
8	VAV-Demand Control Ventilation by CO ₂	●		○	●		
9	VAV-Flow Control	●		○			
10	Cooling with Parallel Fan		●	●	○		
11	Cooling with Parallel Fan + 1 Stage Electric Reheat		●	●	○		
12	Cooling with Parallel Fan + 2 Stages Electrical Reheat		●	●	○		
13	Cooling with Parallel Fan + On-Off Reheat Valve		●	●	○		
14	Cooling with Parallel Fan + Modulating Reheat Valve		●	●	○	●	
15	Cooling with Serial Fan		●	●	○		
16	Heating or Cooling with Serial Fan		●	●	○		
17	Cooling with Serial Fan + 1 Stage Electrical Reheat		●	●	○		
18	Cooling with Serial Fan + 2 Stages Electric Reheat		●	●	○		
19	Cooling with Serial Fan + On-Off Reheat Valve		●	●	○		
20	Cooling with Serial Fan + Modulating Reheat Valve		●	●	○	●	

- Required item for the application
- Optional item for the application